



Sensor's minimum distance from an air vent

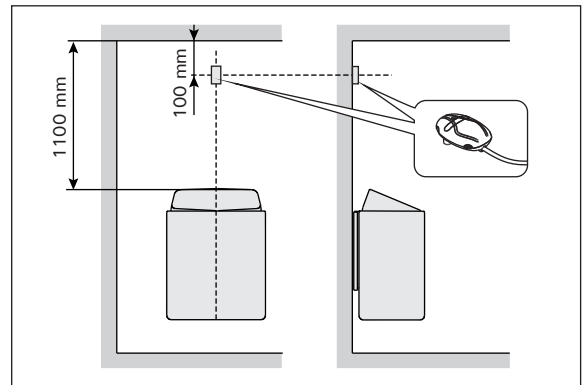

The place of the sensor in connection with wall-mounted heaters

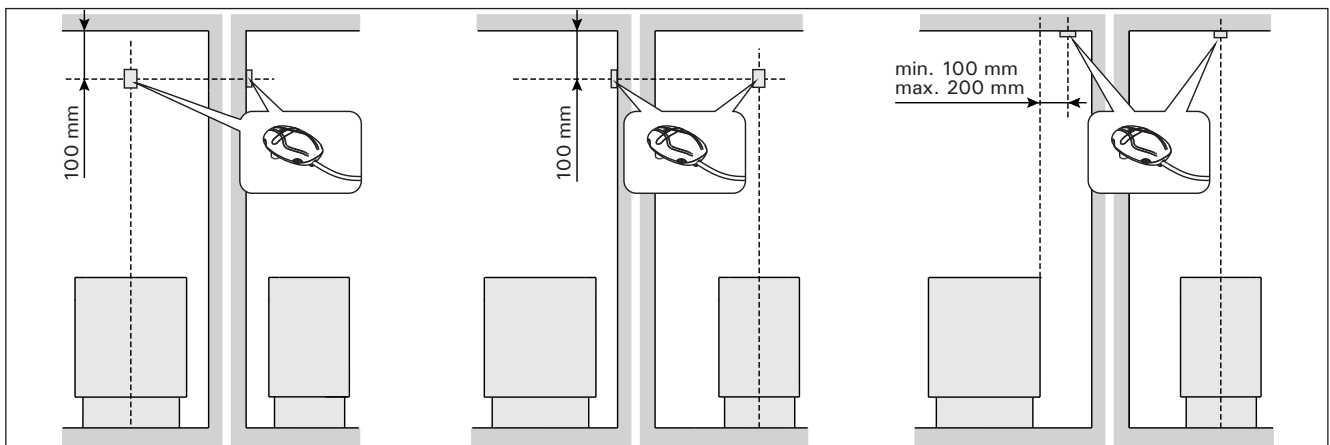

The place of the sensor of the control unit C150 in connection with floor-mounted heaters