


(REMOTE FEEDBACK INDICATION CONNECTIONS)

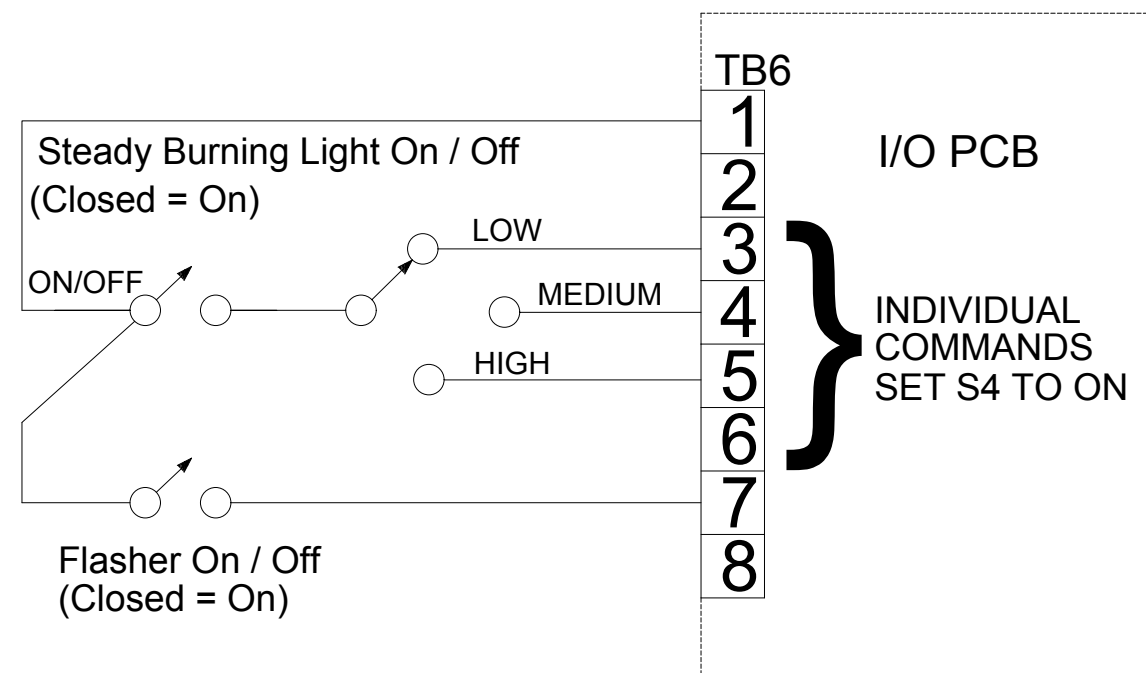

NOTE: 48VDC COULD ALTERNATELY
BE USED AT TB4-1

[illegible]